

PITE 3561 Power Quality Analyzer

Smart measurement and analysis
For 3-phase/4-wire system

PITE 3561 is a 3-phase testing and analyzing device for the quality of power grid. It provides multiple analyzing for electric harmonic, voltage/current/frequency, 3-phase unbalance, power and energy, data recording ,swell/dip, flicker, surge and so on.




Why PITE?

An Easy-to-use power quality tools is a "must-have" for any person who maintains or troubleshoots three phase power. PITE three-phase power quality meters help you locate, predict, prevent and troubleshoot problems in power distribution systems. We offer a full range of trouble-shooters for the prevention and analyzing of the power quality problem. It is not only your problem solver, but also money saver.

Technical Parameter

- ◆ LCD: 5.7" 320 x 240 TFT touch screen
- ◆ Input Impedance: >2MΩ, 20pF
- ◆ Measurement Range: Vrms 10~700V
- ◆ Arms:5A, 10A, 100A, 1000A, 1500A and 3000A (with relative current clamps)
- ◆ Frequency: 30Hz~1000Hz
- ◆ Harmonic Measurement: 1 ~ 50th harmonics
- ◆ Inrush Current: 2000A
- ◆ Peak Voltage: 1000V
- ◆ Internal Memory: 16MB
- ◆ External Memory:256MB
- ◆ Communication Port: USB
- ◆ N.W.(main unit): 1.2 kg
- ◆ Battery: durable for 5 hours after full charge

Functional Displays

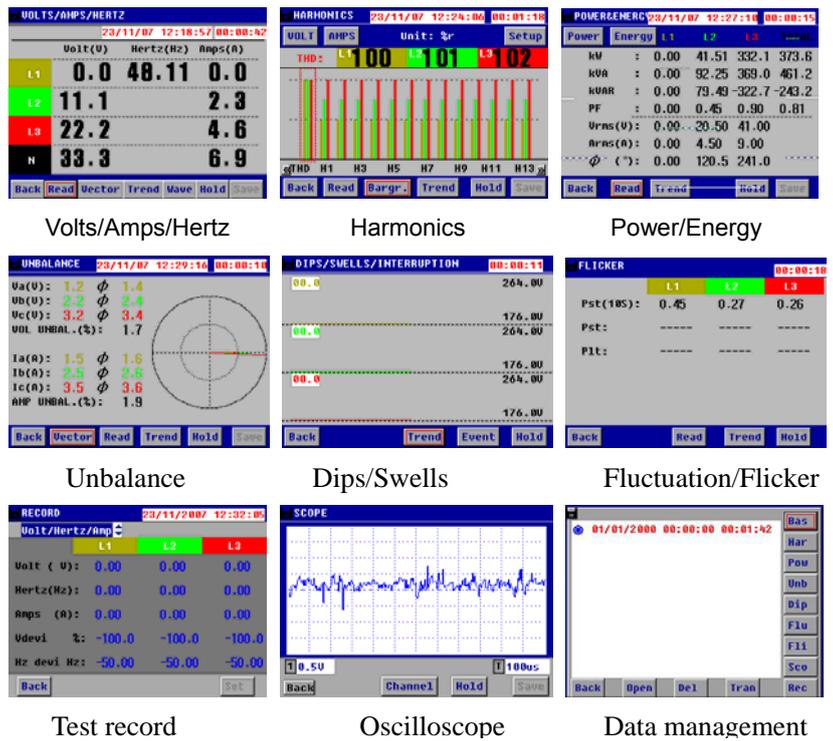

Typical Applications

- ◆ Trouble-elimination: fast measurement and display on screen for trouble-shooting
- ◆ Predictive maintenance: test to avoid power quality problem before malfunction happens
- ◆ Service function: measurement for power quality before users lead-in
- ◆ Long time analysis: recording function help find out unobvious and occasional malfunction
- ◆ Load analysis: check quality of electric system before adding loads
- ◆ Energy evaluation: evaluate energy consumption before installation of energy-saving facilities

Features

- ◆ Portable design and colorful touch screen
- ◆ Applied to standard of EN 50160
- ◆ Could test 3-phase volt, null line volt, 3-phase current, null line current, etc.
- ◆ Up to 50 times harmonic testing with frequency spectrum graph
- ◆ Power testing: 3-phase apparent power, active power, reactive power, power factor, and 3-phase electric power.
- ◆ 3-phase unbalance testing with vivid chart
- ◆ Record at least 40 times of surge current
- ◆ Testing for wave motion, short-time flicker and long-time flicker
- ◆ Record up to 40 times of sag and swell
- ◆ Could have long-time record for basic (stable) power quality parameter. Recording time interval adjustable between 3 second and 30 minutes.
- ◆ Digital oscilloscope, checking waveform for voltage and current signal
- ◆ With PITE DataView software for convenient analyzing of testing result

Accessories



PITE 3561 includes standard parts of 1 carrying case, 3 color-coded current clamps (example of CC-5A shown above), 1 user manual, 5 alligators, 1 USB drive, 2 voltage probes, 1 software CD, 5 voltage testing leads and 1 power adaptor.

Specification

Specifications	Range	Accuracy
Volt/Amp/Hertz	Volt: 10~700V (true rms) Amps: 0.5~3000A (true rms, with relevant current clamp) N current: 0.5~25A (true rms) Current Peak: 0-3000A Volt Peak: 0-1000V Crest factor: 0-10 Hertz: 40~70Hz	Volts: $\pm 0.5\%$ Amps: $\pm 0.5\%$ Hertz: $\pm 0.01\text{Hz}$ <u>NOTE:</u> Take frequency of Phase A as total testing frequency.
Harmonic	Volts: total harmonic +1~50th Amps: total harmonic +1~50th k-factor: 0-10	Volts: $\pm 0.1(\%r)$ Amps: $\pm 1\%$ $\pm 0.5\%$
Power testing	Active Power: 0.05~700KW Apparent Power: 0.05~700KVA Reactive Power: 0.05~700KVAR Power Factor: 0.00~1.00 Active Energy: 0.01~10000kWh Apparent Energy: 0.01~10000kVAh Reactive Energy: 0.01~10000kVARh Average Power Factor: 0.00~1.00	Active Power: $\pm 1\%$ Apparent Power: $\pm 1\%$ Reactive Power: $\pm 1\%$ Power Factor: ± 0.005 Active Energy: $\pm 1\%$ Apparent Energy: $\pm 1\%$ Reactive Energy: $\pm 1\%h$ Average Power Factor: ± 0.005

Unbalance	Fundamental Volts: 10~700V (true rms) Fundamental Amps: 0.5~1000A (True rms) Fundamental Hertz: 40~70Hz Phase Angle: 0~360° Unbalance: 0.0%~100%	Volts: ±0.5% Amps: ±0.5% Hertz: ±0.01Hz Phase Angle: ±0.3° Volt unbalance: ±0.2% NOTE: Take frequency of Phase A as total testing frequency.
Data Recording	Recording for: 3 phase voltage, current, null current, voltage harmonic (THD and 1~25 harmonics), current harmonics (THD and 1~25 harmonics), unbalance, KW, KVA,KVAR, PF, flicker and fluctuation	Time interval: 3s~30min adjustable Time duration: <960 hours
Sags(Dips)/Swells	Volts sag, Volts Swells and instant interruption	Maximally could record 40 times
Fluctuation	Voltage Fluctuation:0.1%~10.0%	≤±5%
Flicker	Short-time and long-time flicker	Short-time: ≤±5%
Scope	3-phase Volts, 4-wire Current, null volt and null current waveform	Max Hertz: 200KHz Min Hertz: 100Hz

Construction

Top



Bottom



Current input is for connection with a one-into-four current testing lead.

USB port is convenient for data transfer to USB drive

Side



Back



Shoulder strap buckle is fastened with a strap, convenient for carrying during testing.

Tilt-out hook facilitates bench top or hanging operation, making it easy to view testing result.

Optional Current Clamps

PITE offers complete range of current clamps (all with a one-into-four testing lead in PITE 3561) for measurement applications up to 3000 Amps.





Order Information

PITE has wide range of configurations to meet different customers' need of both 3 phase/3 wire and 3 phase/4 wire. For other ranges of current clamps not listed here, please kindly contact our sales representatives for availability.

Configuration	Part No.
PITE 3561 Kits	
PITE 3561 with set of 3 color-coded C-5A current clamp and testing leads	Con. #3561.5A
PITE 3561 with set of 3 color-coded CC-10A current clamp and testing leads	Con. #3561.10A
PITE 3561 with set of 3 color-coded CC-20A current clamp and testing leads	Con. #3561.20A
PITE 3561 with set of 3 color-coded CC-100A current clamp and testing leads	Con. #3561.100A
PITE 3561 with set of 3 color-coded CC-500A current clamp and testing leads	Con. #3561.500A
PITE 3561 with set of 3 color-coded CC-800A current clamp and testing leads	Con. #3561.800A
PITE 3561 with set of 3 color-coded CC-1000A current clamp and testing leads	Con. #3561.1000A
PITE 3561 with set of 3 color-coded AmFlex-1500A current clamp and testing leads	Con. #3561.1500A
PITE 3561 with set of 3 color-coded AmFlex-3000A current clamp and testing leads	Con. #3561.3000A

PITE TECH. INC.

4/F, Bldg A, Chiwan Industrial Park, Shaodi Rd., Shekou Area, Shenzhen China

TEL: +86-755-2680 5759 FAX: +86-755-2688 0310

sales@pitetech.com www.pitetech.com